
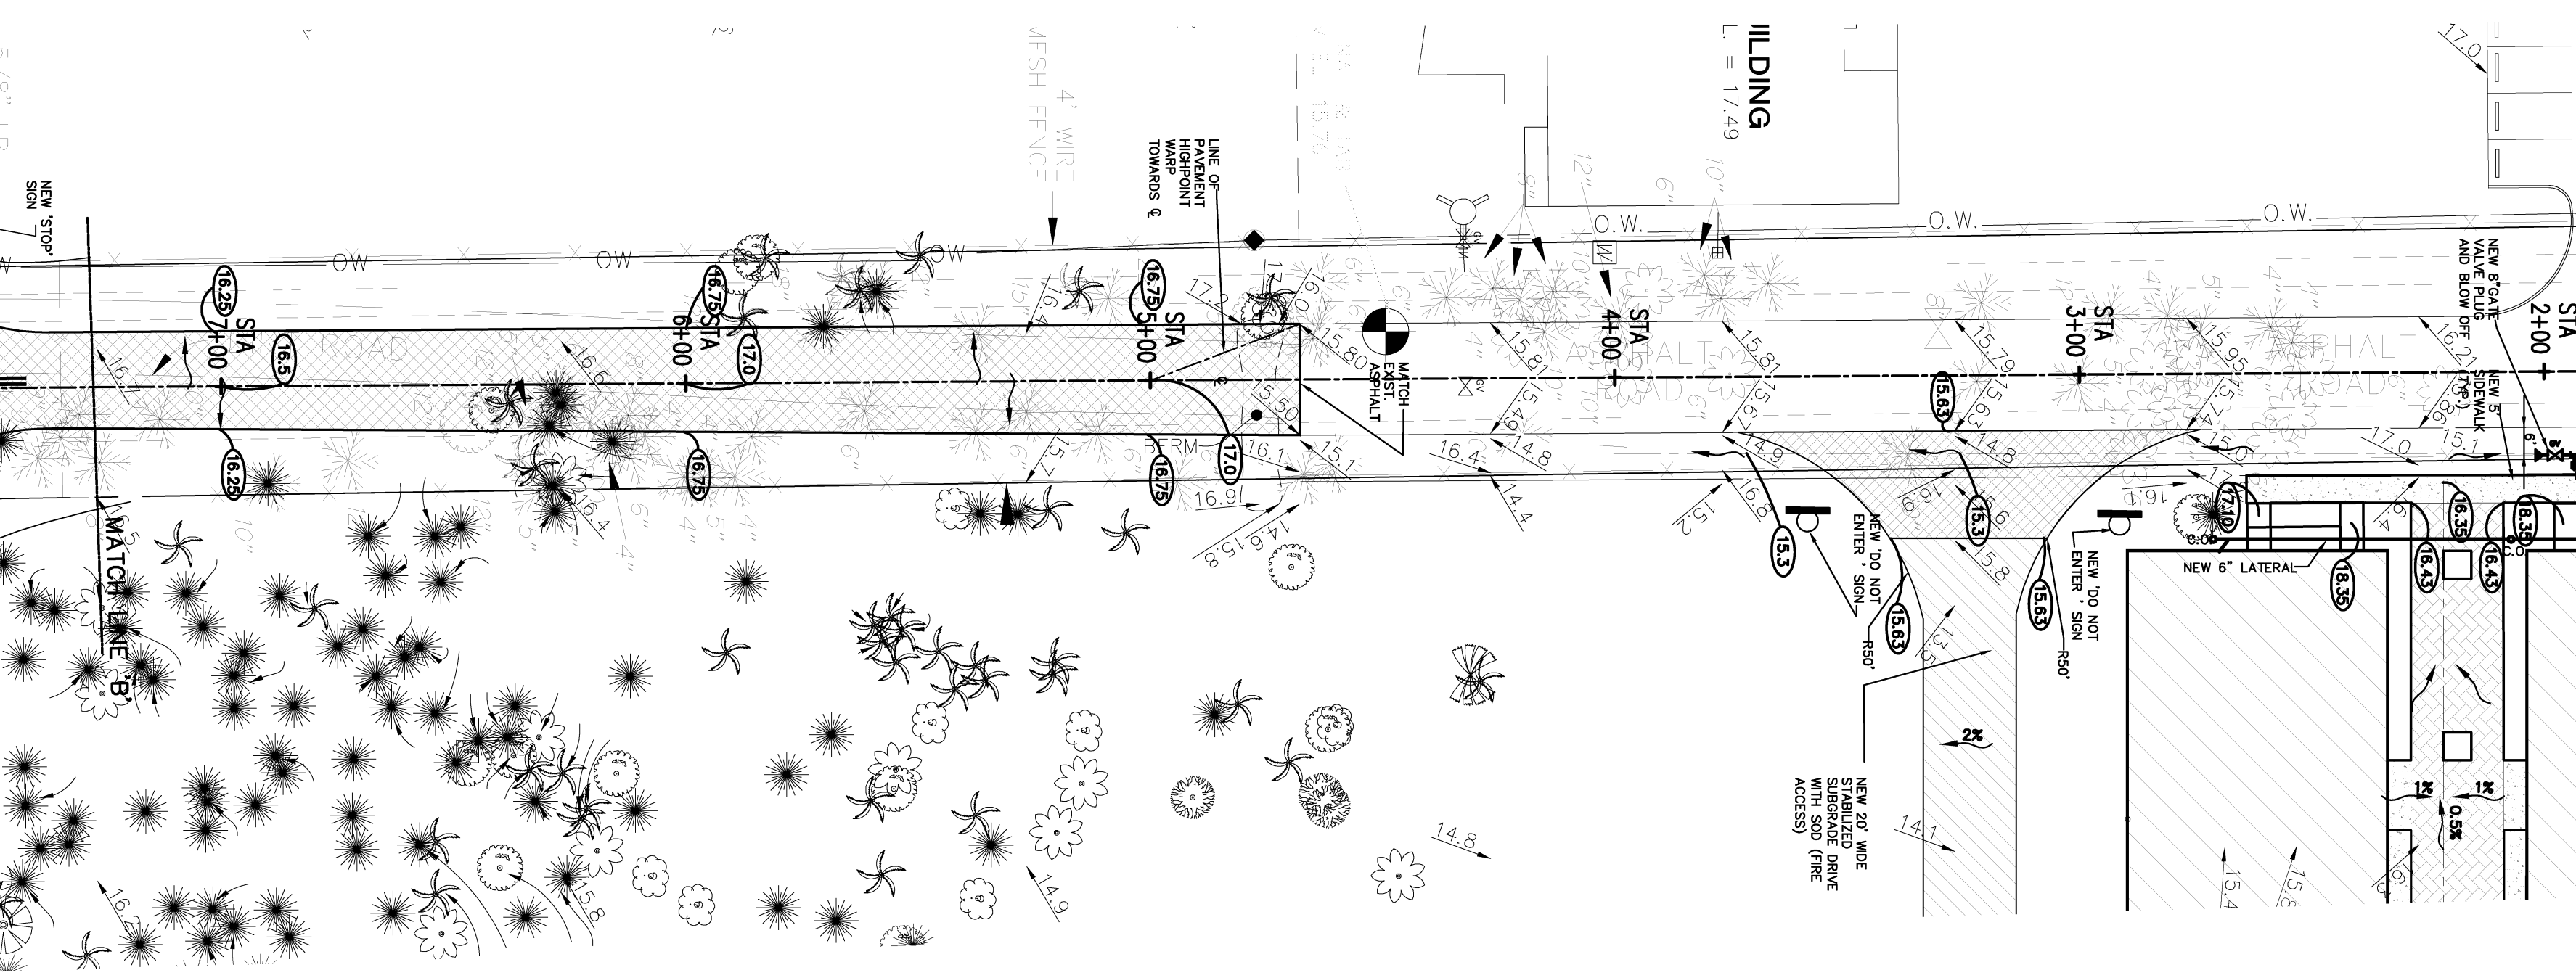
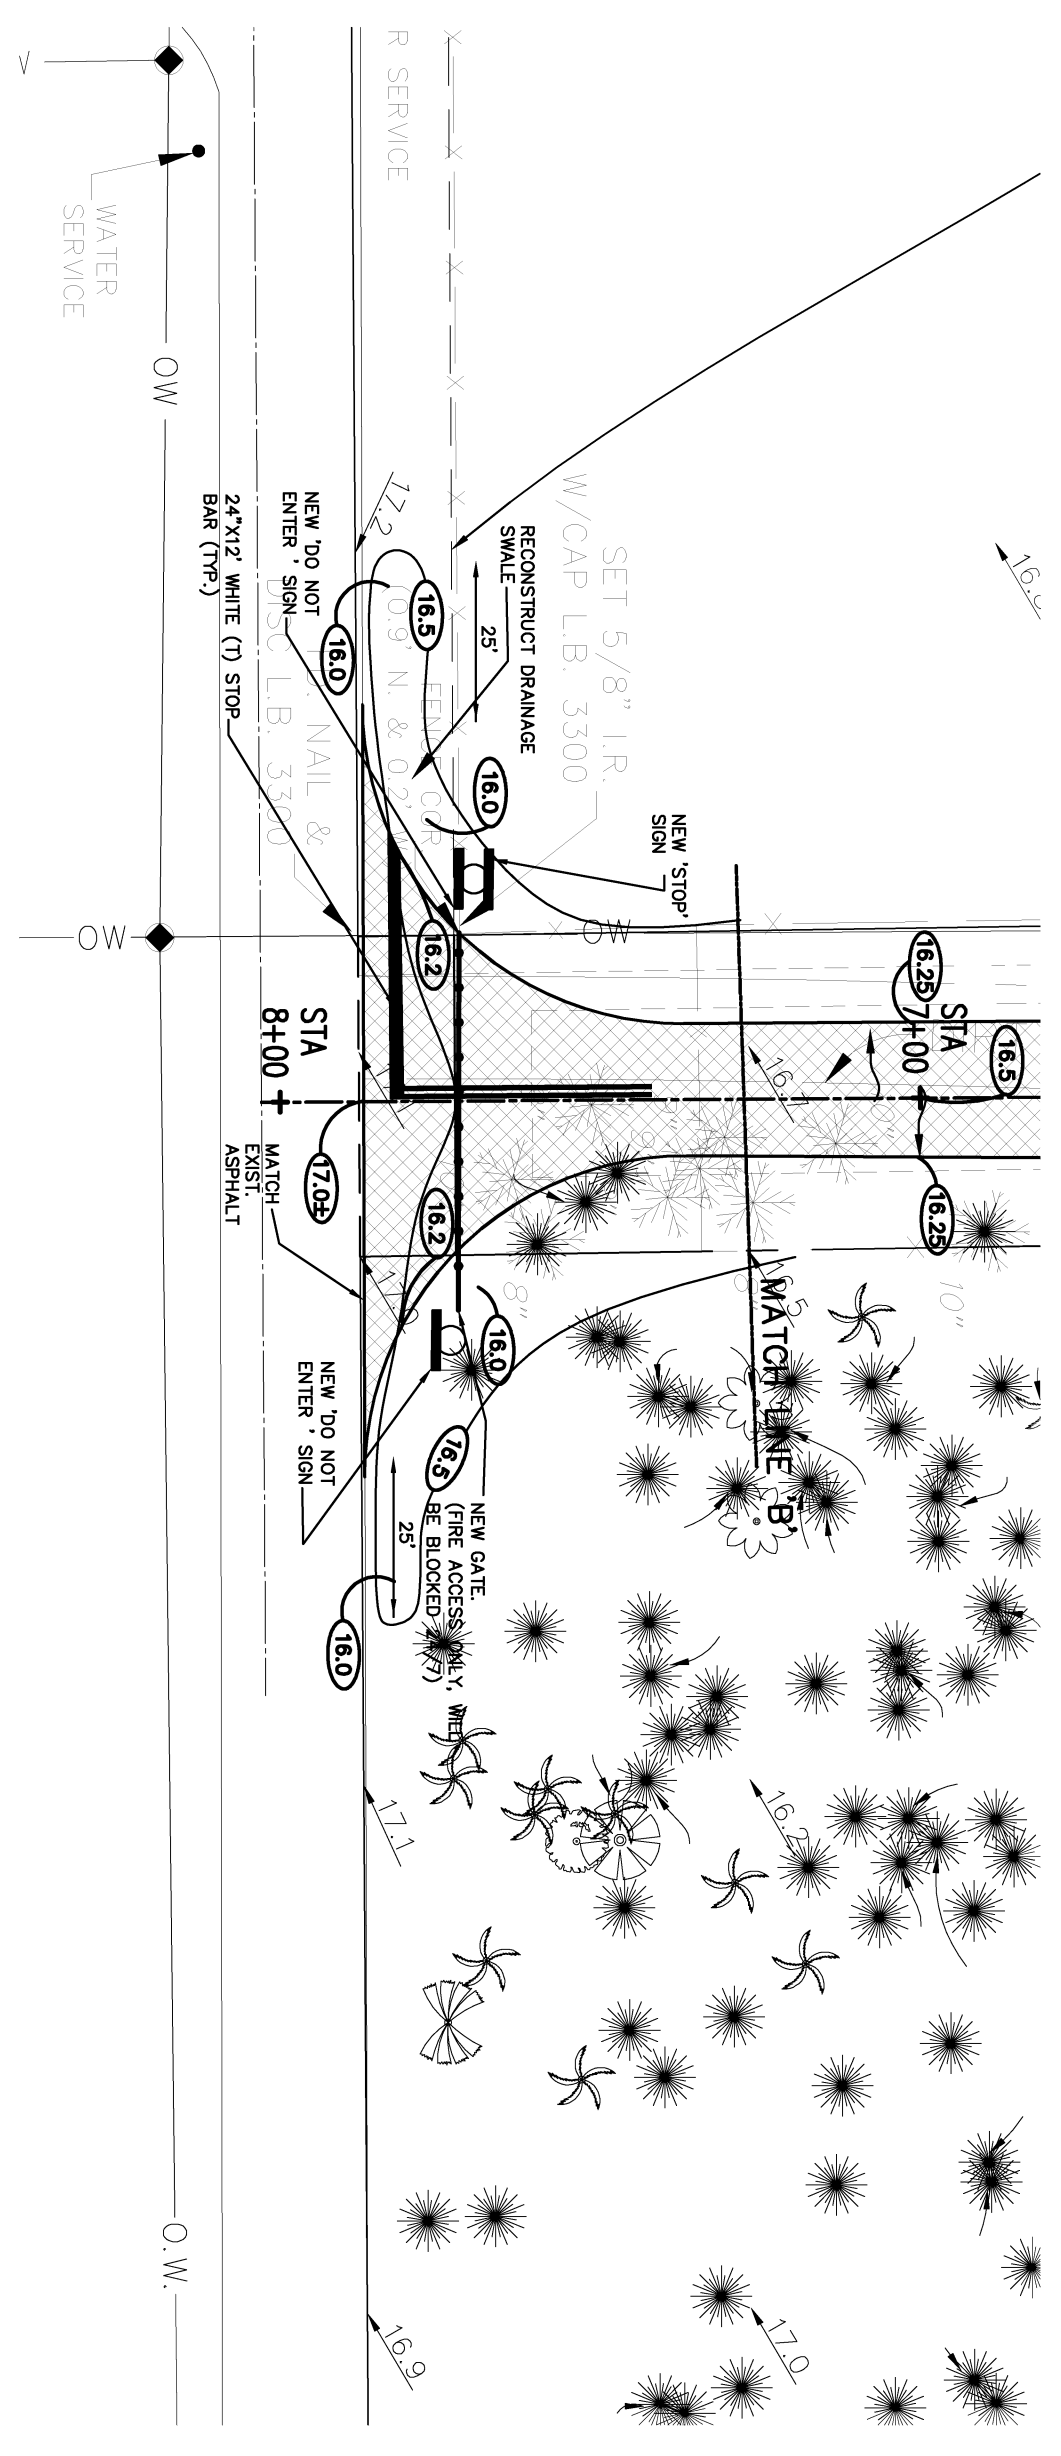


**HANDICAPPED PARKING SPACE**  
 STRIPING PER F.D.O.T. STANDARD  
 INDEX NO. 17346.  
 SCALE 3/8"=1'-0"

**RELOCATE OR CONNECT EXISTING FIRE HYDRANT**  
 SCALE N.T.S.

- NOTES:
1. ALL FIRE HYDRANTS SHALL BE FREE OF CORROSION. ALL WORKING PARTS SHALL BE ANNEALED AND THE HYDRANT SHALL BE PROTECTED BY AN ANTI-RUST COATING. THE 6" OF NOZZLES SHALL BE 18" ABOVE FINISH GRADE AT HYDRANT.
  2. FIRE HYDRANTS SHALL BE 3'-6" BURY LENGTH MAXIMUM. FIRE HYDRANTS WITH BURY LENGTHS GREATER THAN 3'-6" SHALL NOT BE ACCEPTABLE.
  3. THE USE OF FIRE HYDRANT EXTENSION KITS TO SET FIRE HYDRANTS TO GRADE SHALL BE PROHIBITED. ALL FIRE HYDRANTS TO BE RELOCATED OR RECONNECTED SHALL BE 18" ABOVE FINISH GRADE AT HYDRANT.
  4. RECONNECT EXISTING FIRE HYDRANT TO NEW WATER MAIN.
  5. KEEP VALVE AS CLOSE AS POSSIBLE TO THE HYDRANT.
  6. WHEN FIRE HYDRANT "TEE" IS ON P.V.C. PIPE RUN, CONSTRUCT 1 LENGTH OF DUP. (R.L.) PIPE ON EACH SIDE OF FIRE HYDRANT "TEE".

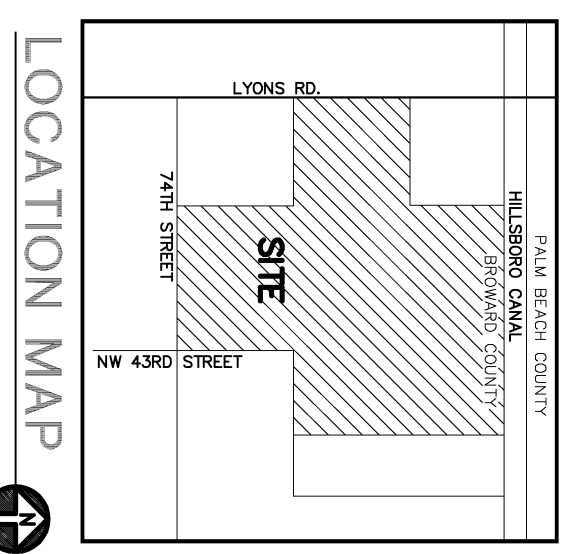

**ENLARGED ENGINEERING PLAN**  
 SCALE 1/8"=1'-0"

**SWM PERMIT SUBMITTAL**

**OWNER**  
 NORTH BROWARD PREPARATOR  
 7800 LYONS ROAD  
 COCONUT CREEK, FLORIDA 33073  
 (772) 954.247.0011  
 (772) 954.247.0012  
 ARCHITECT

**PG&A**  
 791 PARK OF COMMERCE BLVD  
 SUITE 400  
 BOCA RATON, FLORIDA 33487  
 (772) 561.988.4002  
 (772) 561.988.3002  
 AA 000337

**DeRose Design Consultants Inc.**  
 LAND PLANNING • CIVIL • STRUCTURAL  
 ENVIRONMENTAL • ELECTRICAL • MECHANICAL  
 PROJECTS  
 1000 W. STATE ROAD 3080  
 BOCA RATON, FLORIDA 33487  
 (772) 561.988.4002  
 (772) 561.988.3002  
 AA 000337

PROJECT NUMBER: R1007944.00  
 PROJECT LOCATION: 7800 LYONS ROAD COCONUT CREEK, FLORIDA  
 DATE OF ISSUE: MARCH 28, 2013  
 REVISIONS:  
 Δ DRC COMMENTS 5.1.13  
 SWM PERMIT SUBMITTAL 5.13.13

DESIGNER: [Signature]  
 CHECKED BY: LDR  
 DRAWN BY: RW  
 SUBMITTAL PHASE/SET DESCRIPTION: DRC SITE PLAN MODIFICATION  
 APPROVED: [Signature]

**LAMRENCKOWSKI ENGINEER P.C.**  
 LICENSED ENGINEER NO. 88887  
 STATE OF FLORIDA  
 DATE: [Blank]  
 DESIGNER: [Signature]  
 To the best of my knowledge, the information furnished herein is true and correct, and I am not providing any information that I know to be false or misleading. I am not providing any information that I know to be false or misleading. I am not providing any information that I know to be false or misleading.

SHEET NUMBER: **C-2**  
 2 OF 10  
 ENLARGED SITE PLAN

