


- Ⓐ ESD MODEL 4000 GC-3
- Ⓑ ESD SOLID SEPARATOR
- Ⓒ ESD GRASS CLIPPING HEAD
- Ⓓ ESD SHALLOW SUMP

- Ⓔ ESD ROUND SUMP
- Ⓕ ESD OIL/WATER SEPARATOR
- Ⓖ ESD CHEM STORAGE BLDG. 8'x12'
- Ⓗ ESD 10 X 12 MIX/LOAD PAD

- Ⓘ ESD AIR COMPRESSOR, 2HP
115/230, 1Ø, 15.7 AMP.
PORTABLE AND FLEXIABLE HOSE.
- ⓵ STORAGE BUILDING
- Ⓛ ELEC. PWR., 240VAC, 30AMP,
SINGLE PHASE, 3/4"ELEC. CONDUIT
(02 PLACES)

- Ⓜ ELEC. PWR., 240VAC, 40AMP,
SINGLE PHASE, 3/4"ELEC. CONDUIT
- Ⓝ FRESH WATER, 3/4"SCH 40 PVC
- Ⓟ ESD ELEC. CONDUIT, 3/4"ELEC. CONDUIT

- Ⓢ ESD FORCED SUPPLY, 2"SCH 40 PVC
- Ⓡ ESD STUB-UP, 2"S.S. NIPPLE
- Ⓣ ESD GRAVITY DRAIN, 2"SCH 40 PVC
- Ⓢ STUB-UP AS REQUIRED FOR EQUIPMENT

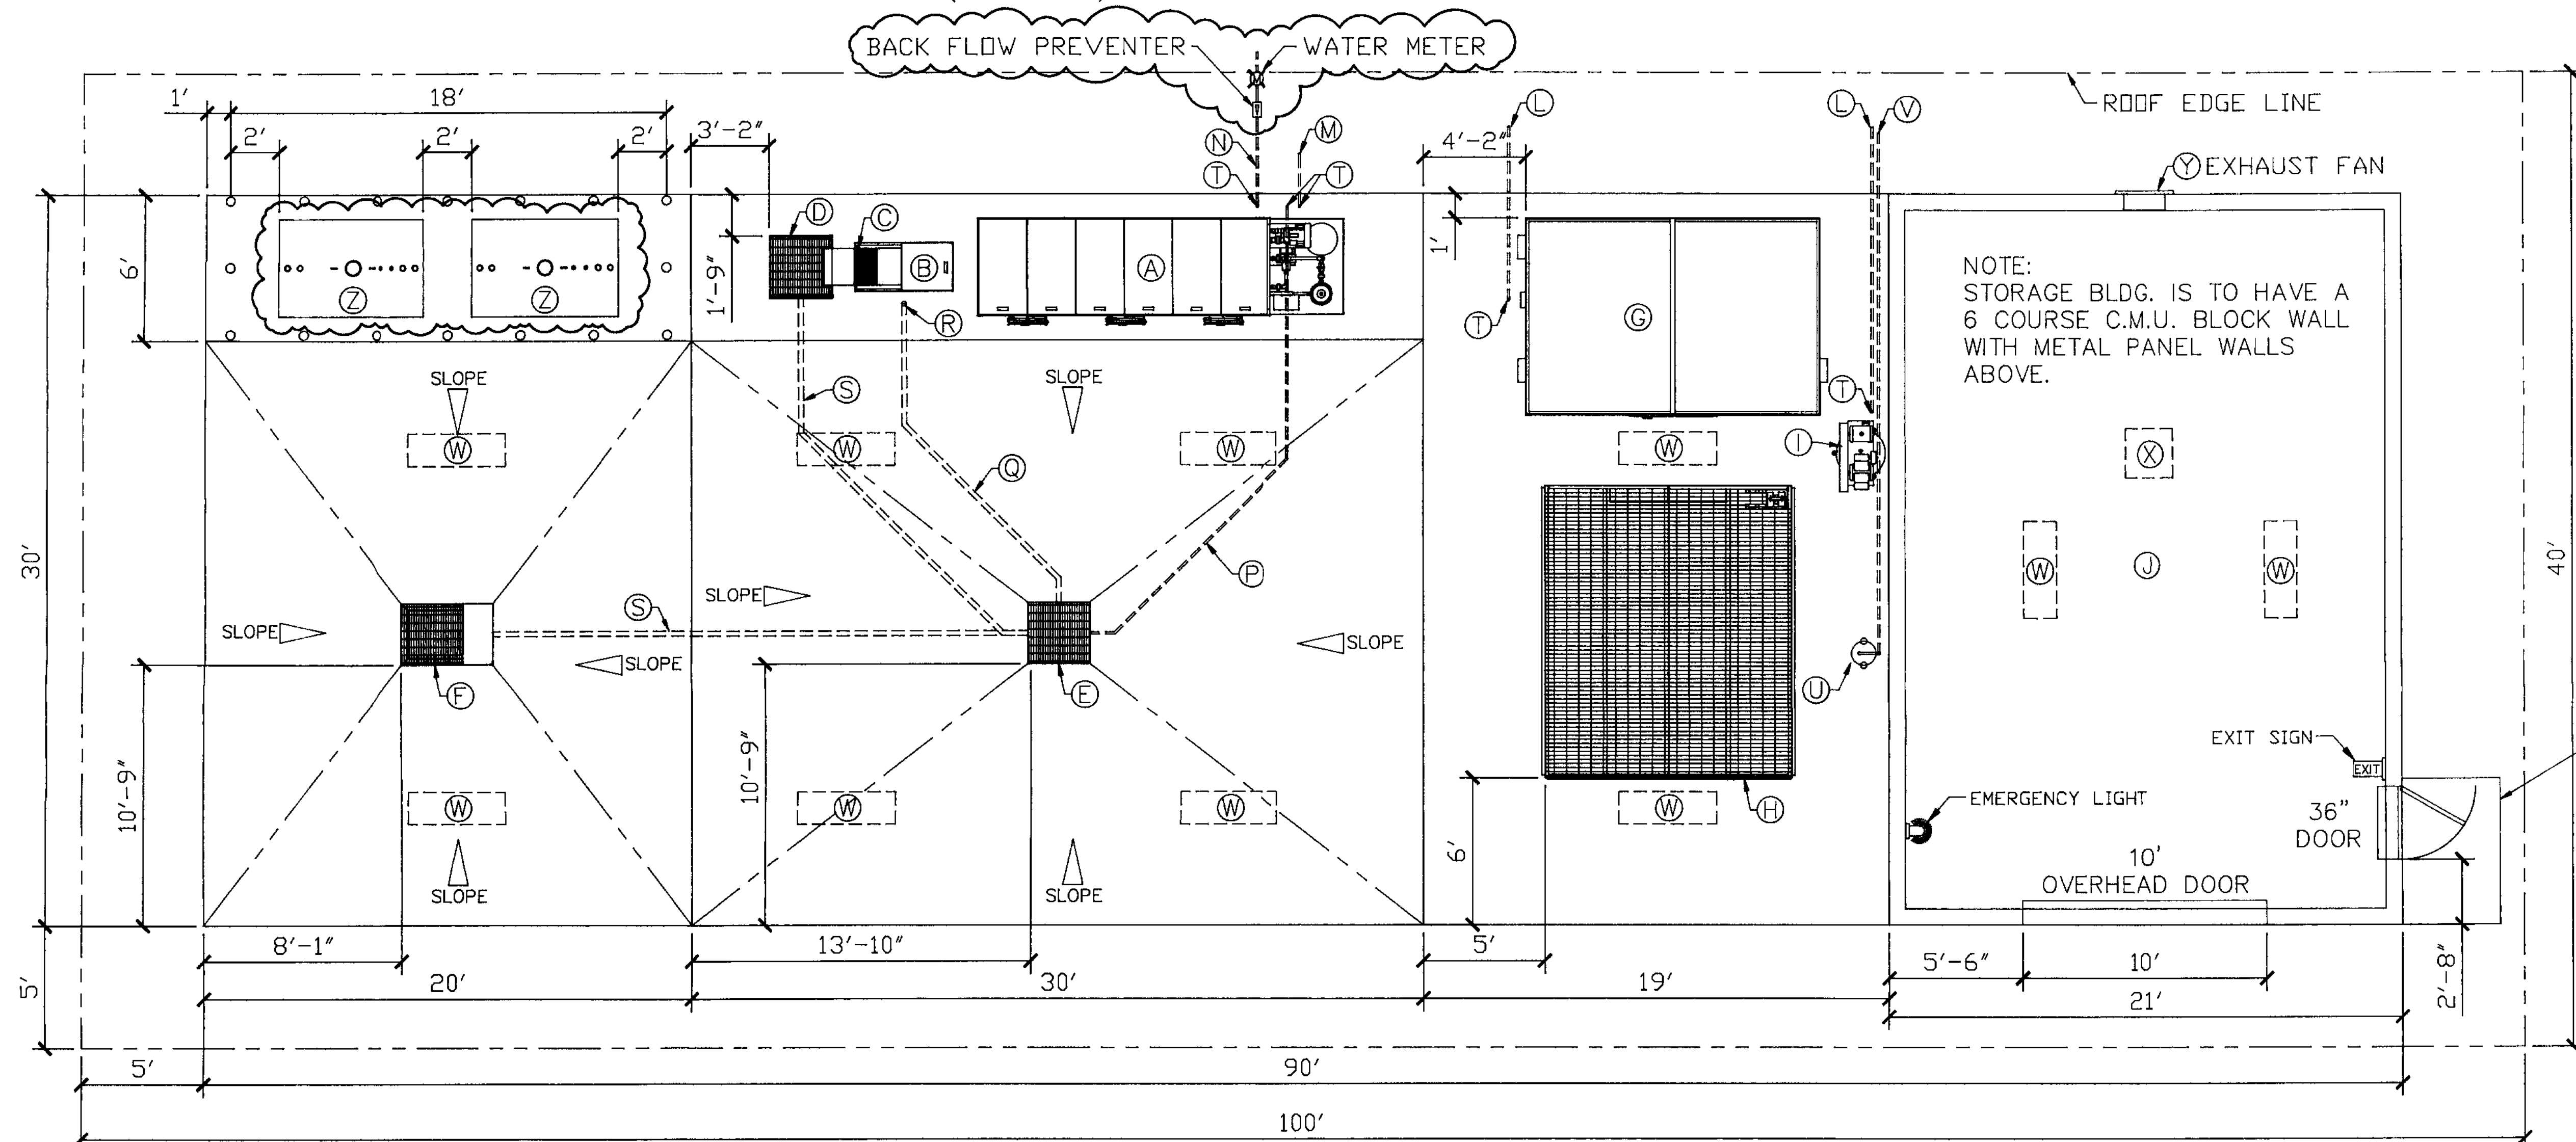

- Ⓤ ESD EMERGENCY SHOWER/EYE-WASH
- Ⓥ FRESH WATER, 1 1/4"SCH 40 PVC,
STUB-UP WITH 1 1/4"S.S. NIPPLE

- Ⓦ OVERHEAD LIGHT (10 PLACES)
- Ⓧ OVERHEAD SKY LIGHT
- Ⓨ DAYTON, 24" DIA., SINGLE SPEED
1/4 Hp, 1 PHASE, 2515 cfm @ .125" H2O

- Ⓩ FUEL TANKS/DISPENSERS (1 GASOLINE,
1 DIESEL) 500 GALLON EACH,
4'DIA. X 6' LONG. (SEE ATTACHED
MEMCO ENGINEERED DRAWING.
DISPENSING PUMPS ARE INTEGRAL TO
TANKS. MEMCO CUT SHEET ATTACHED.)

- NOTE:
- 1) ALL CONCRETE TO BE A MINIMUM OF 8"THICK, 3000PSI, WITH FIBER MESH.
 - 2) SLOPE CONCRETE TO BE 1/4"PER FOOT TOWARDS SUMPS.

STOOP: 6" THICK,
3000 PSI CONCRETE,
WITH WIRE MESH.

1/4" = 1'-0"

ENGINEER OF RECORD:
Daniel E. Wolf
SIGNATURE DATE
DANIEL E. WOLF, PE 46774
PRINT NAME FLA. REG. NR.

DRAWING CONFIDENTIAL:
THIS DRAWING AND ALL INFORMATION
CONTAINED THEREIN IS AND SHALL REMAIN
THE PROPERTY OF ENVIRONMENTAL SYSTEM
DESIGN, INC. AS AN INSTRUMENT OF
PROFESSIONAL SERVICE. THIS INFORMATION
SHALL NOT BE USED WITHOUT THE FULL
KNOWLEDGE AND PRIOR WRITTEN CONSENT OF
ENVIRONMENTAL SYSTEM DESIGN, INC.

REVISION	BY	DATE	DESCRIPTION
REV-1	DW	01/11/06	CITY REQUIREMENTS
REV-2	DW	04/05/06	CITY ADDITIONAL REQUIREMENTS
REV-3	DW	05/03/06	CITY ADDITIONAL REQUIREMENTS
REV-4	DW	05/25/06	CITY ADDITIONAL REQUIREMENTS
REV-5	DW	08/28/06	ADDED STOOP TO SIDE DOOR AND BOLLARDS

DRAWN BY: MLB
ENGINEERING: DW
DATE: 03/10/05
DWG NO: 05550

ESD Waste2Water
2140 N.E. 36th Ave., SUITE 100
Ocala, FL 34470
Phone: (352) 887-7482
Fax: (352) 887-1320

ADIOS GOLF CLUB
ENVIRONMENTAL CENTER LAYOUT

PROJECT NUMBER:
05550
SHEET:
03 of 04