


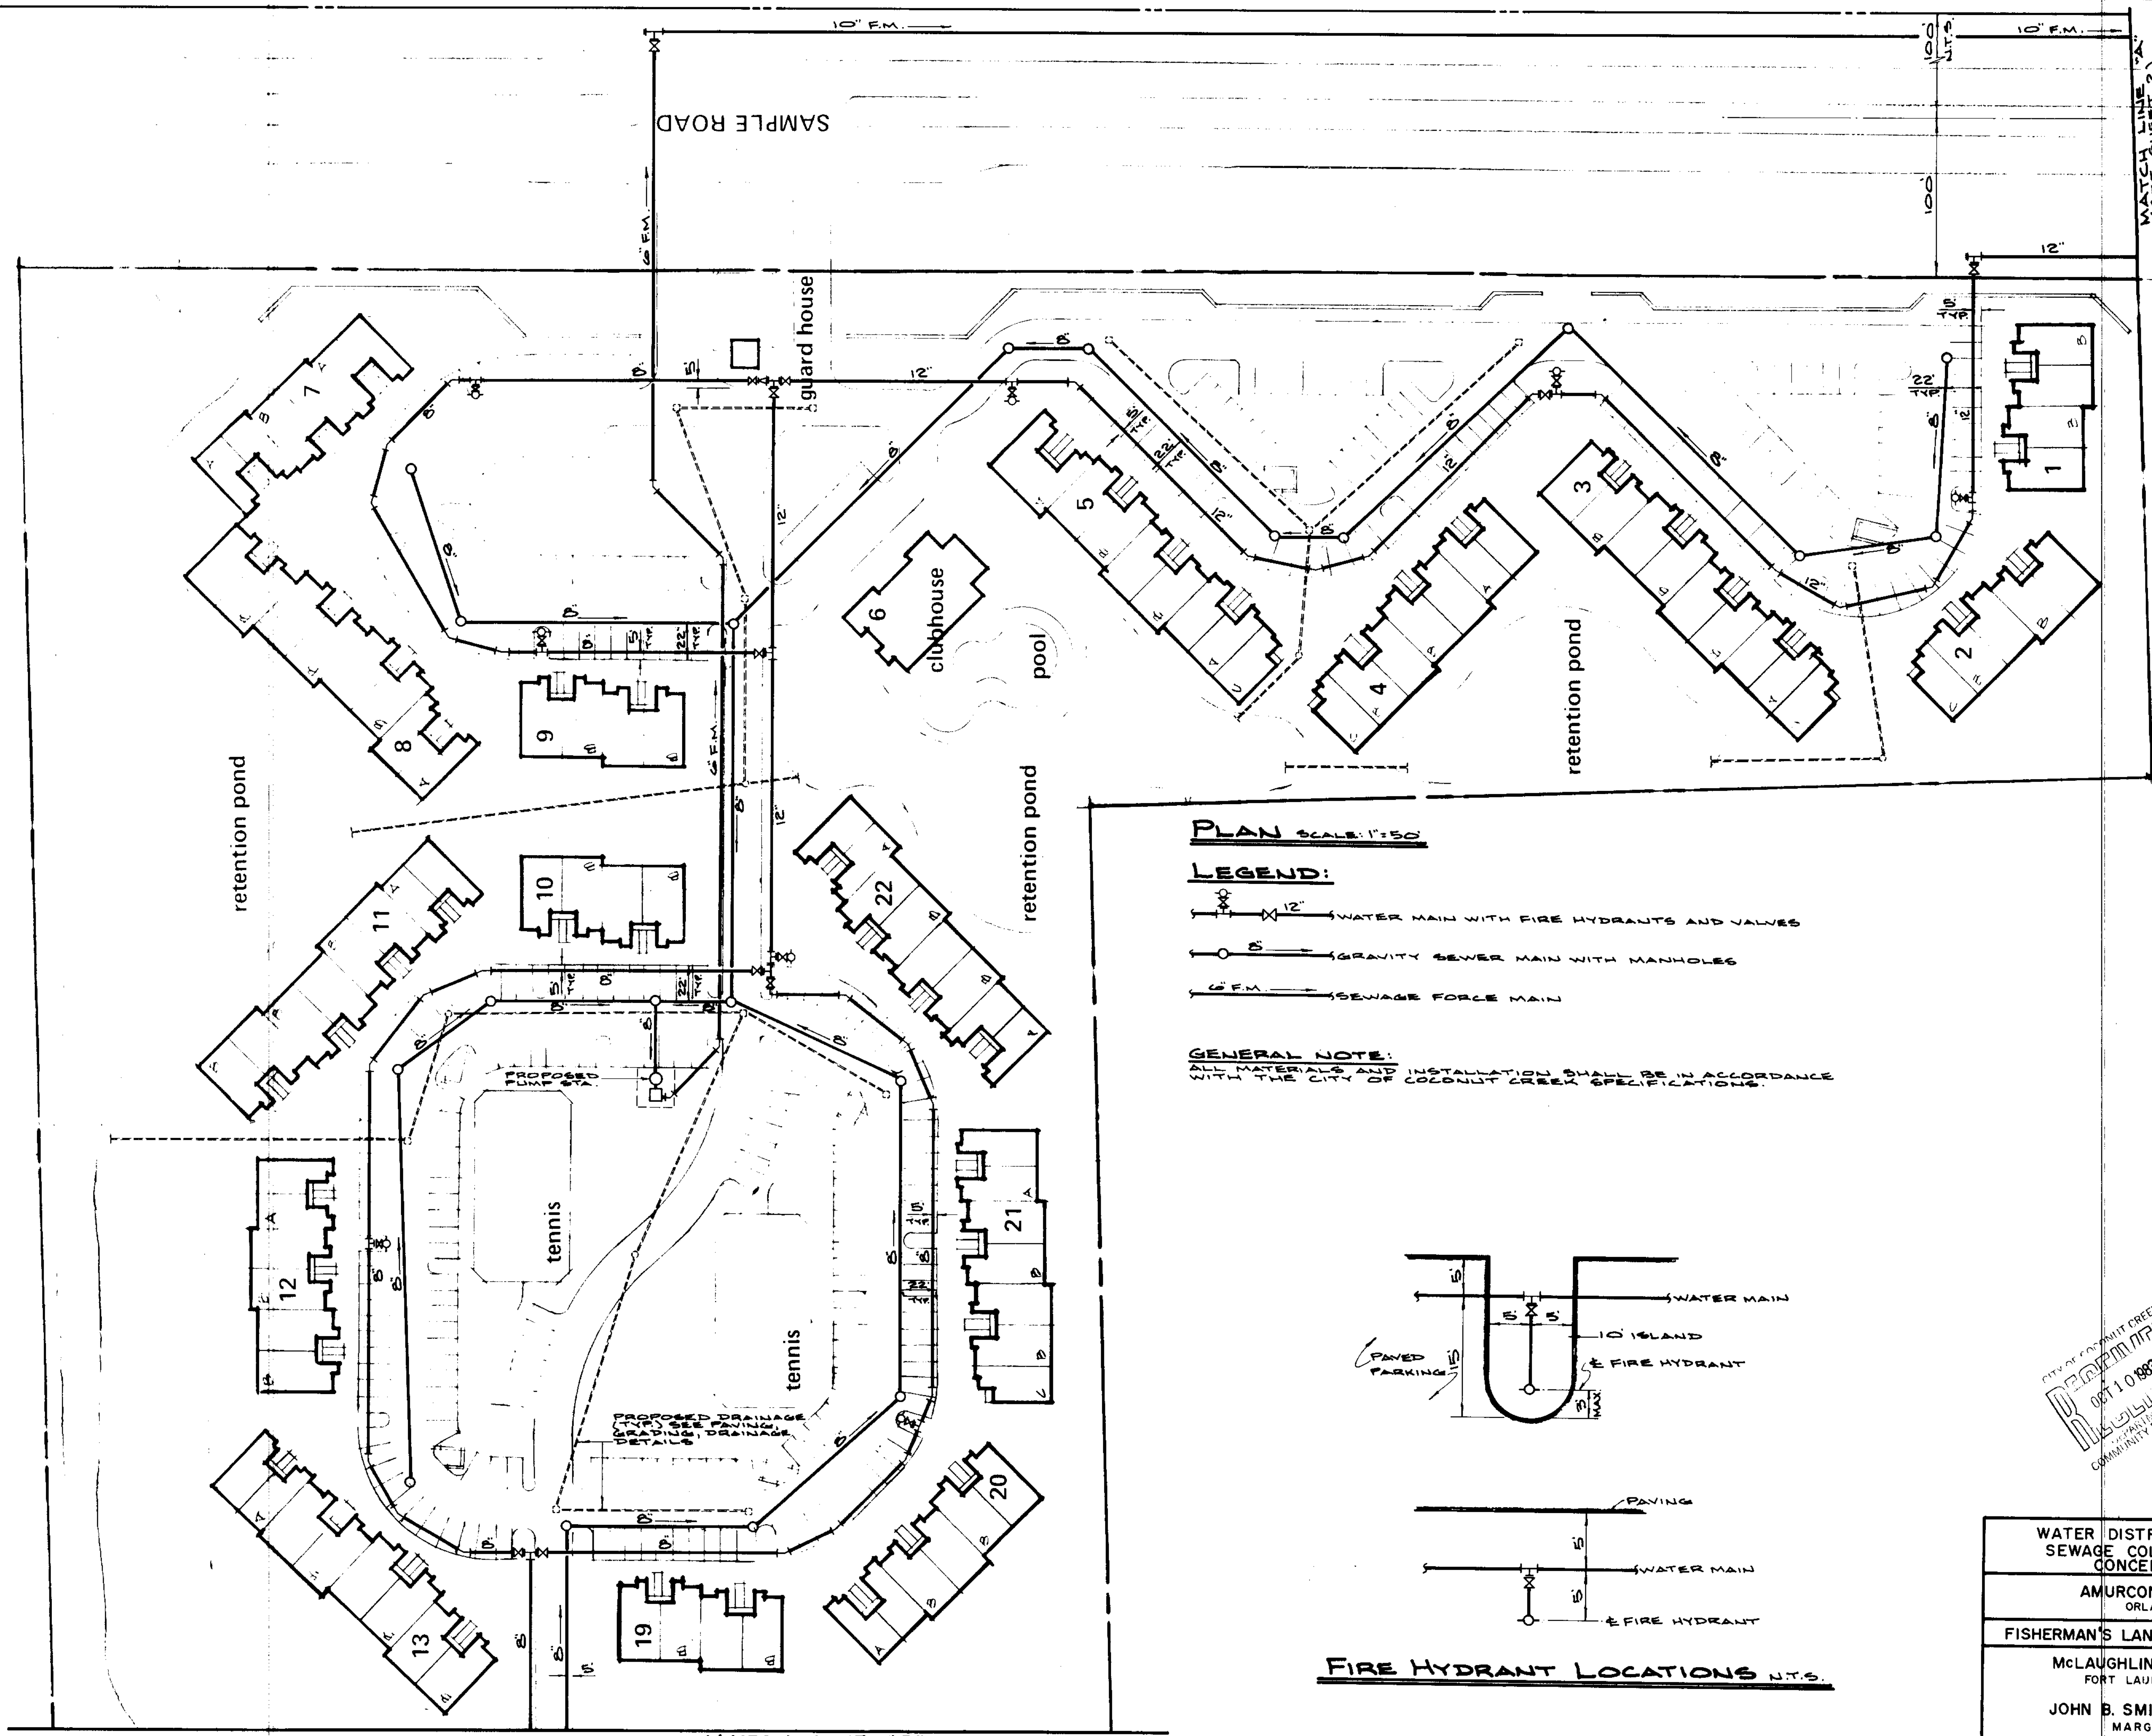


PLAN SCALE: 1"=50'

LEGEND:

- 12" WATER MAIN WITH FIRE HYDRANTS AND VALVES
- 8" GRAVITY SEWER MAIN WITH MANHOLES
- 12" S.F.M. SEWAGE FORCE MAIN

GENERAL NOTE:
ALL MATERIALS AND INSTALLATION SHALL BE IN ACCORDANCE WITH THE CITY OF COCONUT CREEK SPECIFICATIONS.

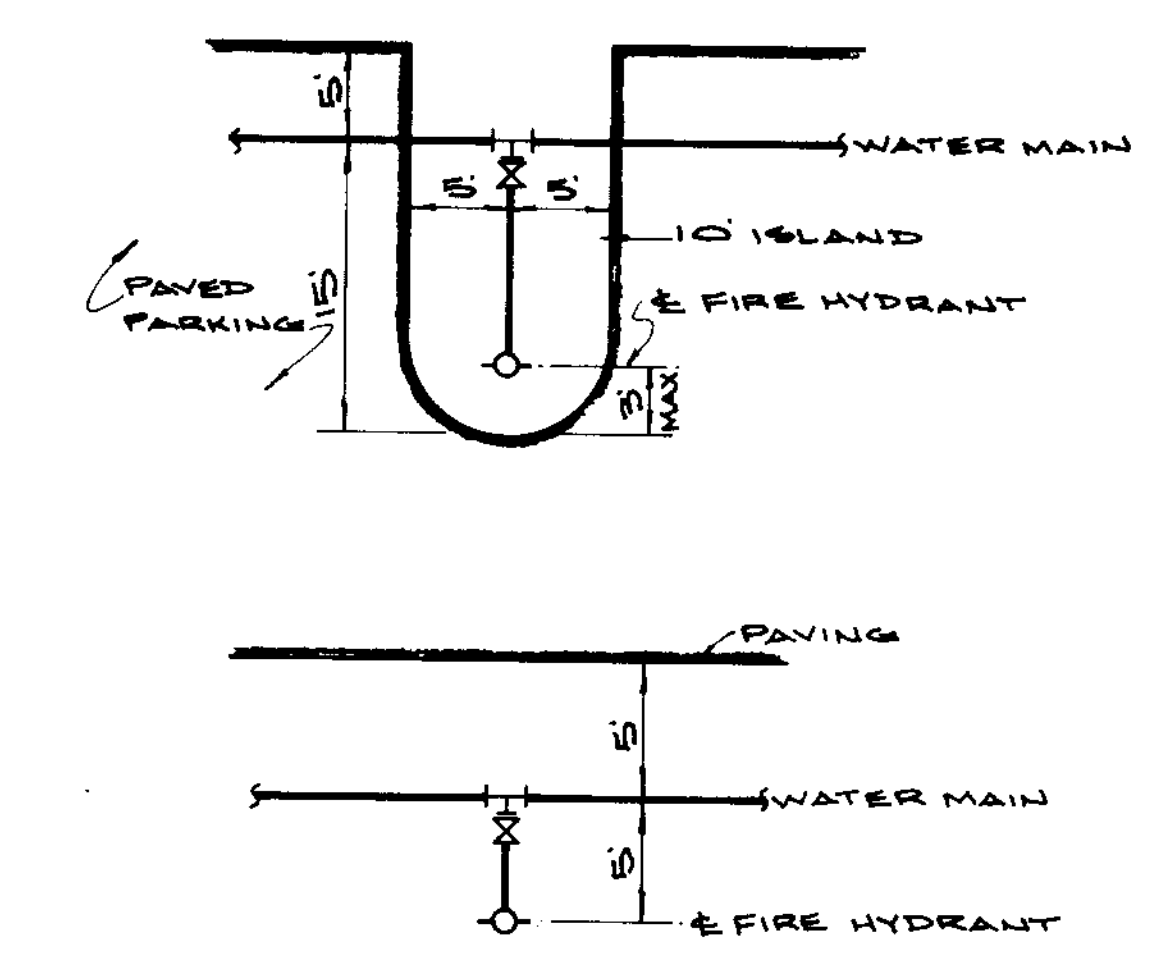

FIRE HYDRANT LOCATIONS N.T.S.



ISSUED
OCT 10 1983

WATER DISTRIBUTION SYSTEM & SEWAGE COLLECTION SYSTEM CONCEPTUAL PLAN			
AMURCON CORPORATION ORLANDO, FLORIDA			
FISHERMAN'S LANDING AT COCONUT CREEK			
McLAUGHLIN ENGINEERING CO. FORT LAUDERDALE, FLORIDA AND JOHN B. SMITH ENGINEERS, INC. MARGATE, FLORIDA			
DESIGN R.C.S.	DRAWN W.E.L.	DATE OCT., 1983	FILE 83-130
Approved By  Registered Engineer No. 31177			SHEET 1 OF 2